




PFAS Monitoring and Follow-Up Actions Under Chapter 246-290 WAC

Key

- Non-detect results path.
- Results with detections path.
- Additional actions when SAL exceeded.

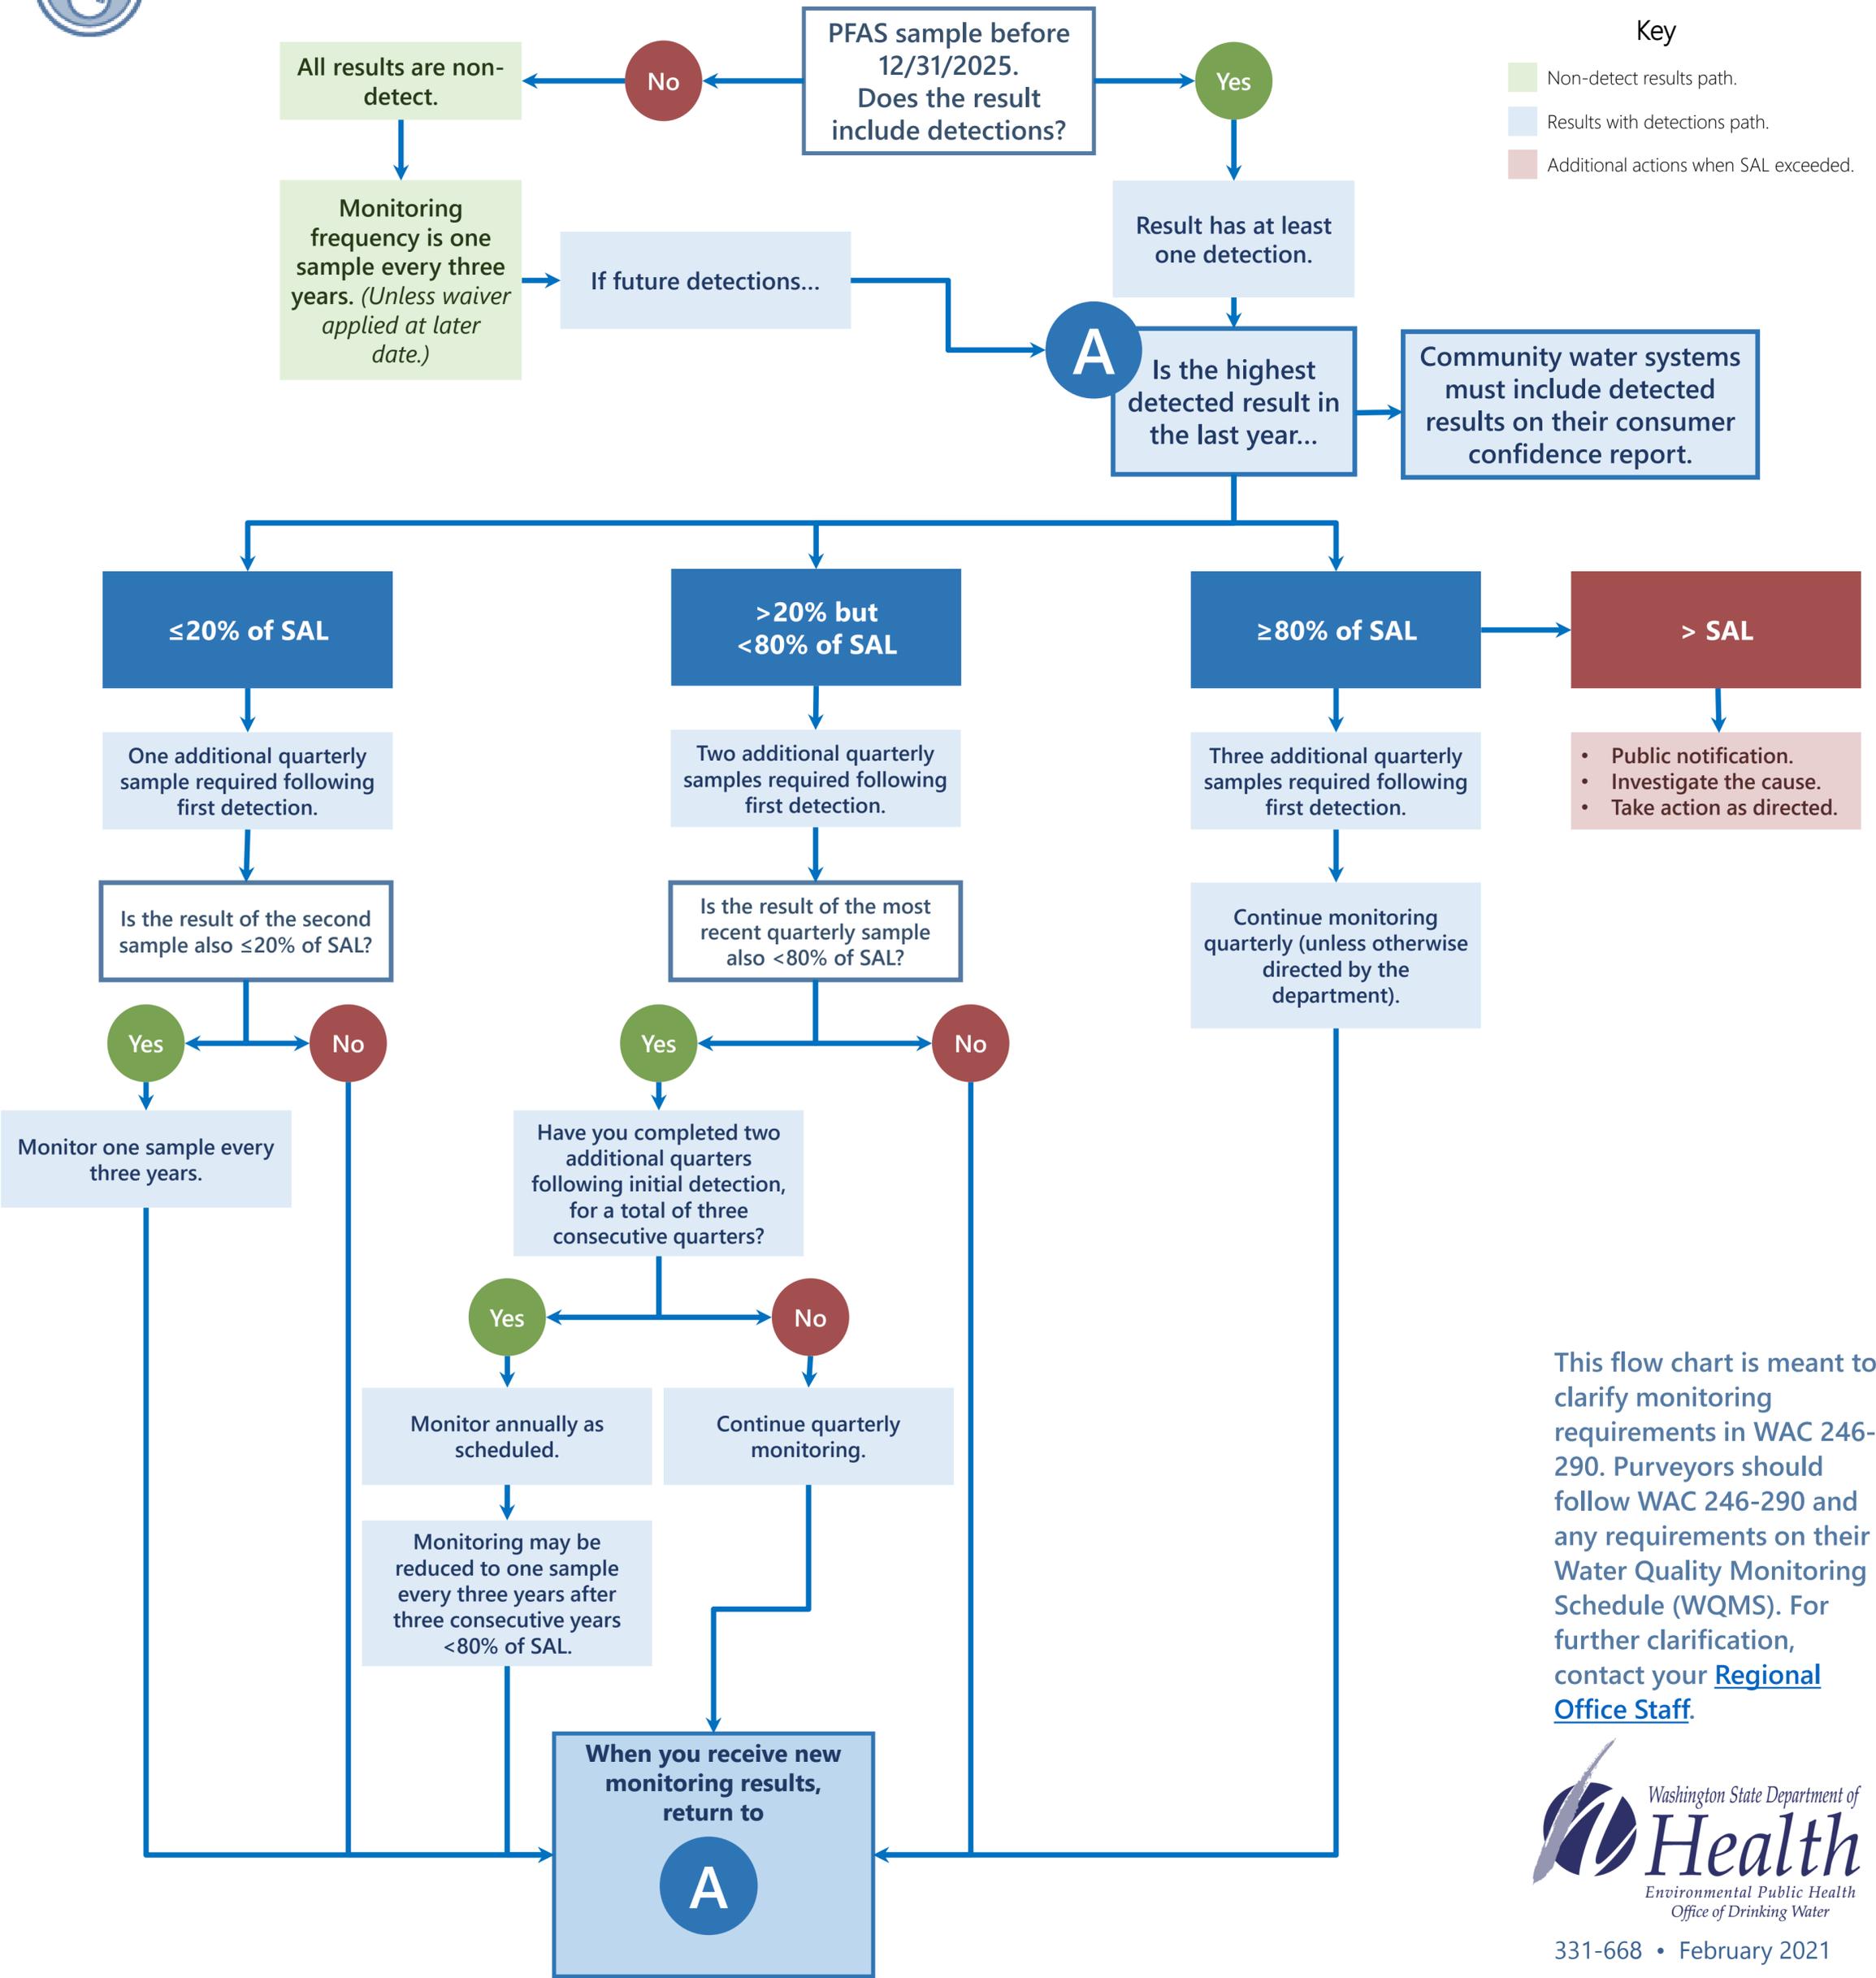

This flow chart is meant to clarify monitoring requirements in WAC 246-290. Purveyors should follow WAC 246-290 and any requirements on their Water Quality Monitoring Schedule (WQMS). For further clarification, contact your [Regional Office Staff](#).

